


**Newflow**

# **Modbus Master Simulator**

**User Manual**



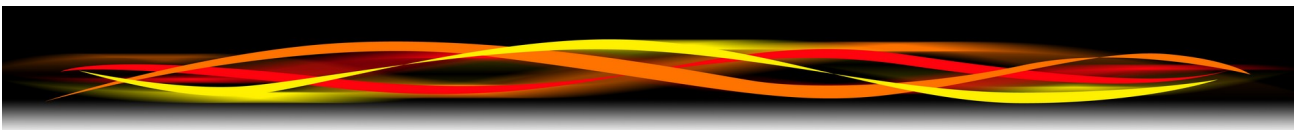

Newflow Ltd  
Unit 4B, 21 Cherry Farm Close  
Malton Enterprise Park  
Malton, North Yorkshire  
YO17 6AW  
UK

Tel: +44 1653 310 000  
Email: [sales@newflow.co.uk](mailto:sales@newflow.co.uk)

## Document Information

Document Name: Modbus Master Simulator User Manual  
Document Identifier: MMS-UM

This document, submitted in confidence contains proprietary information, which shall not be reproduced or transferred to others without prior written permission of Newflow Limited

This document shall not form part of any contract. Specifications are subject to change without notice, and Newflow Ltd accepts no liability of any kind for errors or omissions.

Full contractual terms are available on the website at [www.newflow.co.uk/terms](http://www.newflow.co.uk/terms)

MMXXV

Modbus Master Simulator v2.1.4.0

Serial

TCP

Port

COM4

Baud Rate

19200

Data Bits

8

Parity

Even

Stop Bits

1

Flow Control

None

Frame Counters

Number of polls:

110

Valid responses:

110

Errors:

0

Reset

Sequence

Edit

Go

Current: P1

Poll Time

0.50

Stop

Next: P1

Repeat

0.00

Edit Polls

1

Single Poll

Description

P572 Scaled 32 Bit integers

Slave Addr

1

Function

03 - Read Holding Register

Address Mode

Modicon Addressing

Register Addr

2000

Offset By 1

# of Items

50

Format

uint32

Byte Order

3210

☐ Display Hexadecimal Values

Poll	Address	Value	Description
	2034	0	Prover Time P1-N1 (gated) x 100ns
	2036	0	Reserved
	2038	499999904	Good / A frequency x 100,000
	2040	0	Bad / B frequency x 100,000
	2042	0	RAWIN Frequency x 100,000
	2044	0	Reserved
	2046	0	Density 1 period uSec x 100,000
	2048	0	Density 2 period uSec x 100,000
	2050	0	Reserved
	2052	0	Analog Input 1 mA x 1,000,000
	2054	0	Analog Input 2 mA x 1,000,000
	2056	0	Analog Input 3 mA x 1,000,000
	2058	0	Analog Input 4 mA x 1,000,000
	2060	0	Analog Input 5 mA x 1,000,000
	2062	0	Analog Input 6 mA x 1,000,000
	2064	159	Analog Channel Status
	2066	0	Reserved
	2068	0	DAC 1 - mA x 1,000
	2070	0	DAC 2 - mA x 1,000
	2072	0	Digital Outputs (Bits 0-6)
	2074	0	Pulse Output 1 bucket
	2076	0	Pulse Output 2 bucket
	2078	0	Prover Configuration (1=Run)
	2080	0	Reserved - Writes are ignored
	2082	0	Purge Pulse Output #1 (1=Reset)
	2084	0	Purge Pulse Output #2 (1=Reset)
	2086	125	System Configuration - Pulses
	2088	21845	System Configuration - Analogs
	2090	250	Pulse Output 1 period mSec

(10:03:57.498) TX: 01 03 07 D0 00 64 44 AC

(10:03:57.641) RX: 01 03 C8 00 00 00 CD 00 00 00 D2 00 00 01 95 00 00 00 00 00 00 18 00 00 00

---- Poll:1 #109 ----

(10:03:58.136) TX: 01 03 07 D0 00 64 44 AC

(10:03:58.280) RX: 01 03 C8 00 00 00 CD 00 00 00 D2 00 00 01 95 00 00 00 00 00 00 18 00 00 00

---- Poll:1 #110 ----

(10:03:58.776) TX: 01 03 07 D0 00 64 44 AC

(10:03:58.920) RX: 01 03 C8 00 00 00 CD 00 00 00 D2 00 00 01 95 00 00 00 00 00 00 18 00 00 00

# Table of Contents

<b>1 Introduction.....</b>	<b><u>5</u></b>
<b>2 Installation.....</b>	<b><u>5</u></b>
<b>3 Launching the Program.....</b>	<b><u>6</u></b>
<b>4 The Main Window.....</b>	<b><u>7</u></b>
4.1 Loading/Saving Polls.....	<u>8</u>
4.2 Logging.....	<u>8</u>
4.3 Disabling Poll Values and/or Debug Messages Windows.....	<u>9</u>
4.4 Debug Messages Window.....	<u>9</u>
4.5 Poll Values Window.....	<u>10</u>
4.6 Creating a New Poll.....	<u>12</u>
4.7 Sequence Control.....	<u>14</u>
4.8 Frame Counters.....	<u>15</u>
<b>5 Revision History.....</b>	<b><u>16</u></b>

# 1 Introduction

The Newflow Modbus Master Simulator program can be used for exercising or validating a Modbus Slave device, such as a Coriolis meter, a Gas Chromatograph or a flow computer slave port. The program runs on a Windows PC and supports both serial and Ethernet Modbus/TCP communications.

The simulator can issue a sequence of polls. Each poll can be a read or write to one or multiple registers and coils. Function codes 01, 02, 03, 04, 05, 06, 15 & 16 are supported, along with the Function Code 08 loopback.

All the items in any one poll will be of the same data type, which can be uInt16, uInt32, Int64, Float32, Double64, or a String. Each item in a poll can be given a description for the convenience of the operator.

Live values are displayed in decimal format in the Poll Values window. The raw hexadecimal message data is displayed in the Debug Messages window. Both the Poll Values and Debug Messages windows can be shown or hidden. If hidden, this allows faster polls to be set when stress testing the attached device.

The simulator can handle up to 99 individual polls. These polls can be saved to the PC and loaded again for subsequent use. The files are in XML format and can be edited in a text editor if required.

A sequence engine is included which allows multiple polls to be linked together, and control the rate that the polls are transmitted.

# 2 Installation

The Modbus Master Simulator program is a single executable program and does not require an installer as it only uses a single (auto generating) initialization file to operate.

The file can be placed in any folder, including the desktop, a USB memory stick or a network drive.


The first time the program is closed, it will create the ModbusMasterSimulator.ini file in the same folder as the simulator was run from. This file stores information such as the serial port settings and is used to pre-load the simulator next time it is launched.

### 3 Launching the Program

When the simulator loads, the main window is presented. Depending on whether the program has been run before will determine if the Comms settings are default ones or the ones remembered from the last time the program was run (as these values are stored in the local ModbusMasterSimulator.ini file).

To select the transport mechanism required, choose the required tab between Serial (for Serial Communications) or TCP (for Ethernet TCP communications). Screenshots are shown for both options below;

#### SERIAL

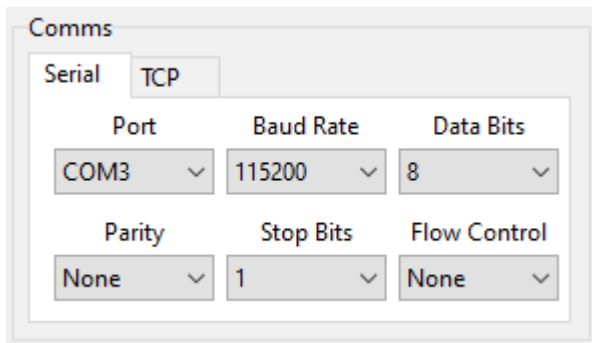


The SERIAL Comms settings window shows the following configuration:

Port	Baud Rate	Data Bits
COM3	115200	8

Parity	Stop Bits	Flow Control
None	1	None

#### TCP

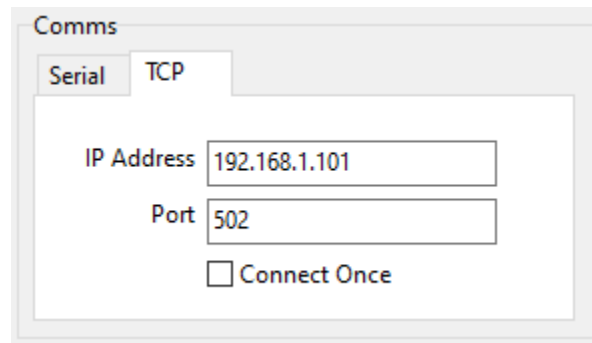

The TCP Comms settings window shows the following configuration:

IP Address
192.168.1.101

Port
502

☐ Connect Once

The settings are as follows;

#### In Serial mode;


Select the Serial Port of the PC from the pulldown list given, then choose the Baud Rate, number of Data Bits, Parity, number of Stop Bits and Flow Control as required by the Modbus Slave device.

#### In TCP mode;

Enter the IP Address and Port of the Modbus Slave device. Previous settings are remembered however the port number defaults to 502 if no previous value is available. This is the commonly used Modbus TCP port number.

The Connect Once tick box configures the simulator to open the port on the Modbus Slave device and keep it open until the simulator is closed or the IP Address or Port are changed. If the tick is removed, the simulator will open and close the port on the Modbus Slave device for each poll.

## 4 The Main Window

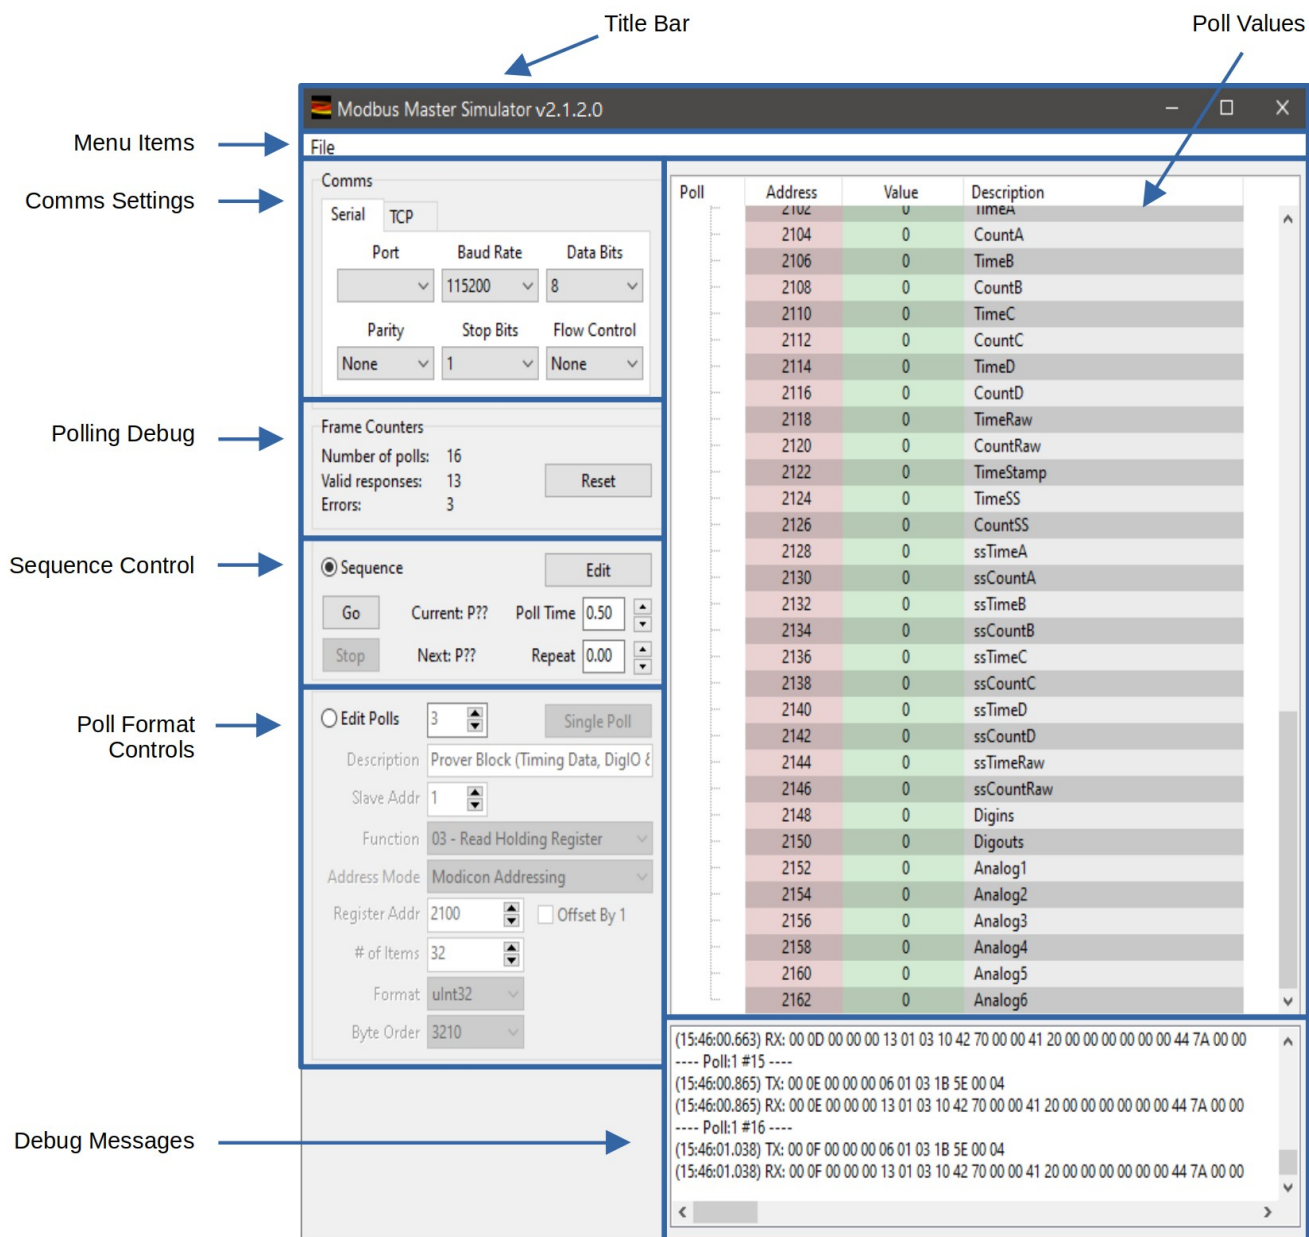


The title bar shows the name of the program and the version running. Below there is the File menu item.

The File menu has five options, these allow the saving and loading of poll files, sets options for logging and sets which windows are visible. See [4.1 Loading/Saving Polls](#), [4.2 Logging](#) and [4.3 Disabling Poll Values and/or Debug Messages Windows](#).

The Polls are constructed for each poll message in the Edit Polls (Poll Format Controls) section. Full details including the format are described in [4.6 Creating a New Poll](#).

The Sequence Control area is used to configure multiple polls, and is explained in detail in [4.7 Sequence Control](#).

## 4.1 Loading/Saving Polls

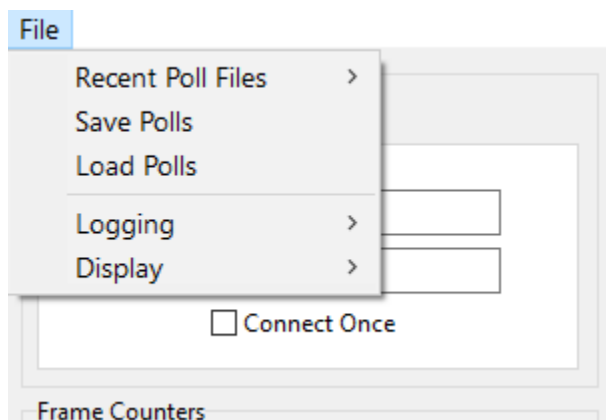


To save the work in building these polls each time the program is run, in the File menu, choose either Load Polls or Save Polls.

Select the folder that the polls are to be saved to or loaded from. If loading, select the file and if saving type the name of the file.

A shortcut is also provided under the File menu to quickly load Recent Poll Files.

**NOTE:** Files are stored with a .xml suffix.

## 4.2 Logging

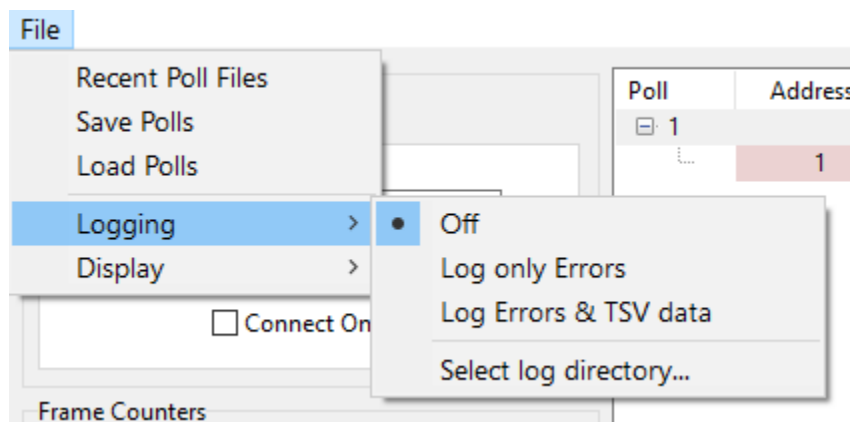


In the File menu, choose Logging and select the level of logging required by clicking on the relevant option, then choose the folder to store the log.

The Debug Messages window shows the last 1000 lines, whereas logging to a file will keep all messages.



### 4.3 Disabling Poll Values and/or Debug Messages Windows


To hide the Poll Values or Debug Messages windows of the application, in the File menu, choose Display and tick/untick the windows required by clicking on the relevant option.

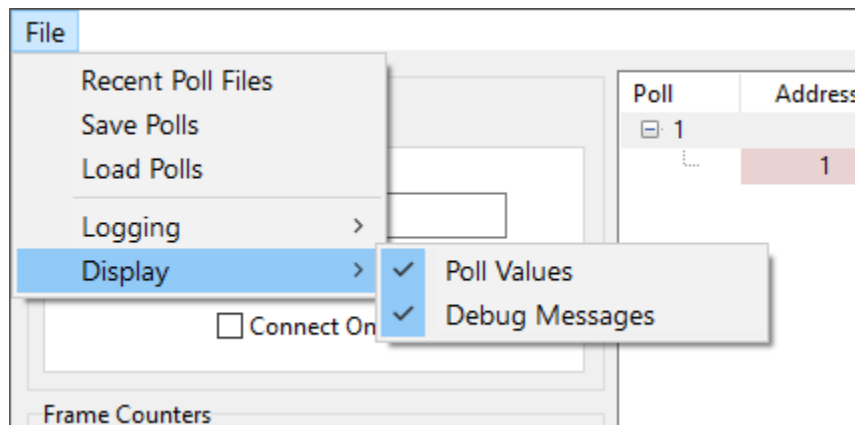

Disabling both of these two features will decrease the CPU load of the application, however little diagnostics are then available.

Decreasing the CPU load also allows polls to be performed quicker, with poll rates in excess of 100 per second achievable.

### 4.4 Debug Messages Window

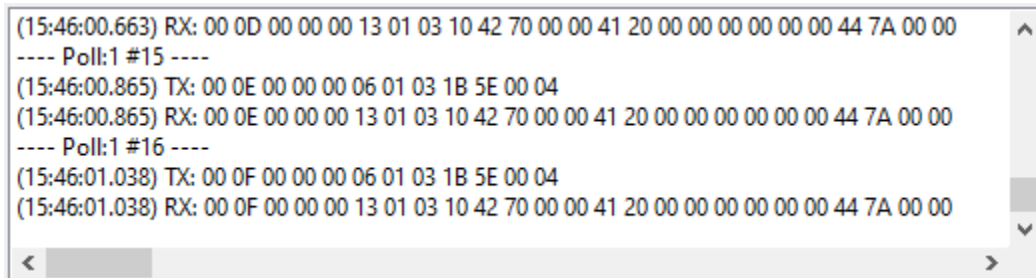

This displays the sent and received Modbus Messages in their Hexadecimal form with timestamps. The Poll and number is displayed as a header above the message and response.

Individual lines can be selected by left clicking on them with the mouse/trackpad.

Multiple lines can be selected by left clicking and dragging the cursor, or using shift+click to select a range of lines.

Right clicking in the message window allows the user to copy all of the lines to the clipboard, copy just the selected lines to the clipboard, or to clear the window (useful when debugging to remove irrelevant entries).

## 4.5 Poll Values Window

The Display Table has two modes;

- Edit Polls mode
- Sequence mode

In either mode, the top row shows the headings, Poll, Address, Value and Description.

On the second row, under Polls it shows both the Poll number and an expand/collapse box. Clicking the box toggles this between + and – to hide or show the registers/addresses in the poll.

When collapsed, under the Value heading, the data type is shown and the Modbus function code (under the Description heading).

In Edit Polls mode, only the poll selected is shown. When in Sequence mode, all polls in the sequence are shown (as below):

<input type="checkbox"/> Display Hexadecimal Values			
Poll	Address	Value	Description
+ 1		uint32	Function: 03 - Read Holding Register
+ 2		uint32	Function: 16 - Preset Multiple Registers
+ 3		uint32	Function: 03 - Read Holding Register

In either Edit Polls mode or Sequence mode, if a poll is expanded, the next rows show the address/register information.

Poll	Address	Value	Description
1		uint32	Function: 03 - Read Holding Register
	2000	205	P513 Hardware Version
	2002	210	P513 Software Version
	2004	405	P572 Firmware Version

The Addresses will start at the Register Address selected and will increment as defined by the Address Mode for each subsequent address/register.

If the Number of items (in each poll) is increased, addition addresses will be shown.

On any new addresses/registers the Value fields will show as zero and the Descriptions will be blank.

On new or existing address/register information, double clicking in the Description field allows the user to add or edit the description text for each item.

If the poll is a read poll, the value field will show the value retrieved from the Modbus Slave device. If however, the poll is a write type poll, the value can be double clicked and the value set to the value required to be sent to the slave device.

The value field can be shown in decimal or hexadecimal notation. Untick/Tick the option to alternate the values. See examples below;

☐ Display Hexadecimal Values

Poll	Address	Value	Description
.....	2010	0	Digital Inputs (Bits: 0-8)
.....	2012	2048	Prover Status
.....	2014	323846	Message Id (2Hz)
.....	2016	0	Reserved

☒ Display Hexadecimal Values

Poll	Address	Value	Description
.....	2010	0x00000000	Digital Inputs (Bits: 0-8)
.....	2012	0x00000800	Prover Status
.....	2014	0x0004F106	Message Id (2Hz)
.....	2016	0x00000000	Reserved

## 4.6 Creating a New Poll

Each poll can be a minimum of one datapoint up to a maximum of 99 datapoints.

Checks are made on the validity of the message being sent, with regard to the message length. Should this exceed the maximum length set out in the Modicon Modbus specification, the Single Poll button will grey out and the wording will change to 'Poll Too Big'.

The options vary depending on the format chosen as shown and detailed below.

<b>Edit Polls</b>	This is a radio button. Selecting <b>Edit Polls</b> deselects the Sequence editing function and vice-versa.
<b>POLL</b>	Up to 99 different poll messages can be handled for any one instance. All of these poll messages can be saved, for subsequent use. Each poll message is given a number and a description can also be added for each poll to identify each poll if a polling sequence is generated.
<b>Single Poll</b>	Clicking this button causes the simulator to request the currently selected poll once. If enabled, the Poll Values and/or Debug Messages windows will also be populated. If the message defined is too big to be valid, this button will be greyed out so it cannot be pressed and the text will change to 'Poll Too Big'.
<b>Description</b>	This Description field allows a name to be associated with each poll. Keeping the name to less than 20 characters will ensure the whole name can be displayed in the Sequence Editor.
<b>Slave Addr</b>	This can be 1 to 256. There are up and down arrows to change the value or it can be typed in directly.
<b>Function</b>	This is the Modbus function code. The simulator supports Functions 01, 02, 03, 04, 05, 06, 08, 15 & 16.
<b>Address Mode</b>	The Address Mode field is used to select Modicon or Logical Addressing. If the format below is set to uInt16 this will always be one address. However if the Format is set to uInt32, this would be a single address in Logical Addressing mode but two addresses in Modicon Addressing mode.

<b>Register Addr</b>	This is the Modbus Slave register address which data is being read from or written to.
<b>Offset by 1</b>	In Modicon Addressing mode, it is normal that the addresses are offset by 1, so if you are looking at 7001, the poll actually requests address 7000. This is not guaranteed though. A tick box is therefore provided to easily enable this or not, without the need to repopulate the map with new register address details.
<b># of Coils or # of Items</b>	This is the number of items requested by each poll.
<b>Format</b>	This is a pull down box, which defaults to uInt16, but can be chosen between uInt16, uInt32, Int64, Float32, Double64 or String.
<b>String Length</b>	If the <b>Format</b> is set to String, this is the number of characters to be requested or sent. The addresses shown in the Poll Values window will then be updated accordingly.
<b>Byte Order</b>	The Byte Order options depend on the <b>Format</b> selected. For example uInt16 only has two bytes of data, so there are only two options, 10 (Big-Endian) or 01 (Little-Endian), whereas Float32 has four bytes of data therefore options of 3210, 0123, 1032 or 2301 are provided.

**NOTE:** The Modbus Function, Data Type and Format will be the same for all registers within any one poll.

To add additional polls, increment the **POLL** number, and repeat the process above.

## 4.7 Sequence Control




The Sequence Control dialog box features a 'Sequence' radio button and an 'Edit' button. Below these are 'Go' and 'Stop' buttons. The 'Current' field is set to 'P3', and the 'Next' field is also 'P3'. The 'Poll Time' is set to '0.50' and the 'Repeat' is set to '0.00'. Both time fields have up and down arrow buttons for adjustment.

The sequence section allows the user to poll a number of register addresses in sequence.

To enter the sequence mode the “Sequence” radio button must be pressed, this deselects the Edit Polls section. If no current sequence is defined, the Sequence Editor will be automatically opened.

If a sequence has already been defined or the user wants to change the sequence, the Edit button should be pressed, this will also open the Sequence Editor.

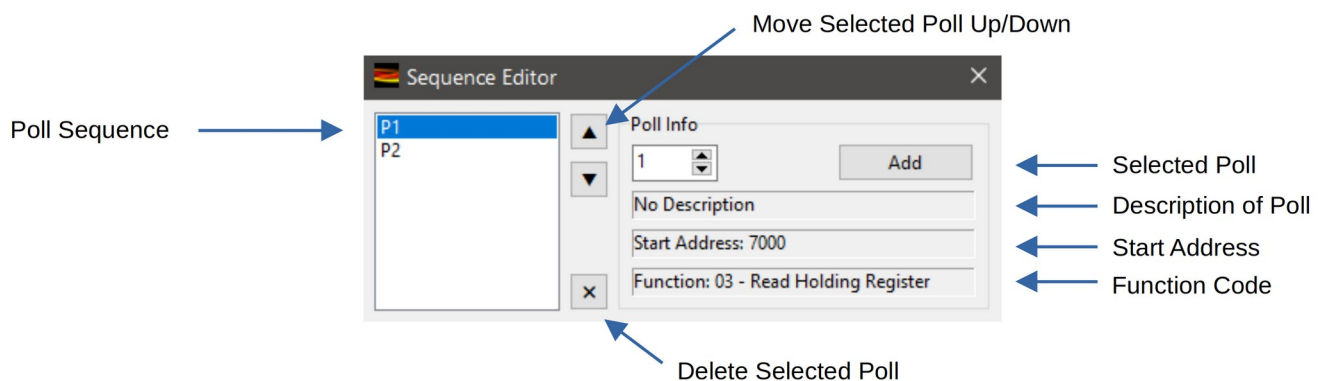


The left hand pane shows the poll sequence that is already configured. An empty list signifies that no sequence is currently defined.

To add polls to the sequence use the up and down arrows to increment the Poll value (or the value can be typed in directly to the number field). The poll description, start address and function code is shown to assist identification. Press the Add button to add the poll into the sequence.

If the poll sequence is in the incorrect order, each poll can be selected, then by using the up and down arrow buttons, can be moved up or down the polling order. Duplicate polls are also allowed so the user could define, as an example; P1, P2, P1, P3.

Polls can be removed from the sequence by selecting them in the list and pressing the X button (Delete).

Once the polling sequence is as required or the user wants to exit the editor, the X (Close) button in the top right hand corner of the Sequence Editor should be pressed.

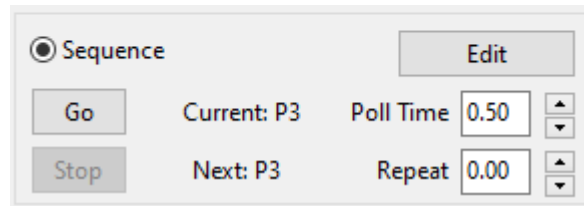

Sequence configuration panel. It includes a radio button labeled "Sequence" which is selected. To its right is an "Edit" button. Below the radio button are two rows of controls. The first row contains a "Go" button, the text "Current: P3", the text "Poll Time", a text box containing "0.50", and a vertical spinner control. The second row contains a "Stop" button, the text "Next: P3", the text "Repeat", a text box containing "0.00", and a vertical spinner control.

In the main window, when a current sequence is defined, the polling can be started/stopped with the “Go” and “Stop” buttons. The “Go” will be greyed out and unable to press if no sequence is defined.

The “Poll Time” value is the time between polls. The “Repeat” value is the time after a sequence has completed till it starts again. These values can either be edited using the relevant up and down arrows or by typing a value in directly.

Between the “Go” and “Stop” button and the poll timers, a diagnostic is provided to show the current and next polls that are due to be performed.

## 4.8 Frame Counters



Frame Counters panel. It displays three rows of data: "Number of polls: 1", "Valid responses: 0", and "Errors: 0". To the right of these values is a "Reset" button.

The Frame Counters show the number of polls that have been performed, how many valid responses have been received and how many errors have been recorded.

A Reset button is also provided so that the values can be reset to aid diagnostics.

## 5 Revision History

Rev	Date	Changes	Prepared	Checked	Authorized
0	19 Aug 2014	Initial	GPL	Josh	GPL
1	9 Mar 2023	Program Version: 1v9	MOB	GPL	MOB
2	29 Jul 2024	Program Version: 2.1.1.0	GPL	MPFJ	GPL
3	12 Nov 2024	Program Version: 2.1.2.0 Bugfix to Fn6 & Fn16 – no interface or operational changes	GPL	GPL	GPL
4	22 Jul 2025	Program Version: 2.1.4.0 Various Bugfixes, added Hex/Decimal display format	GPL	MOB	MOB
5					
6					

End of Document

---